



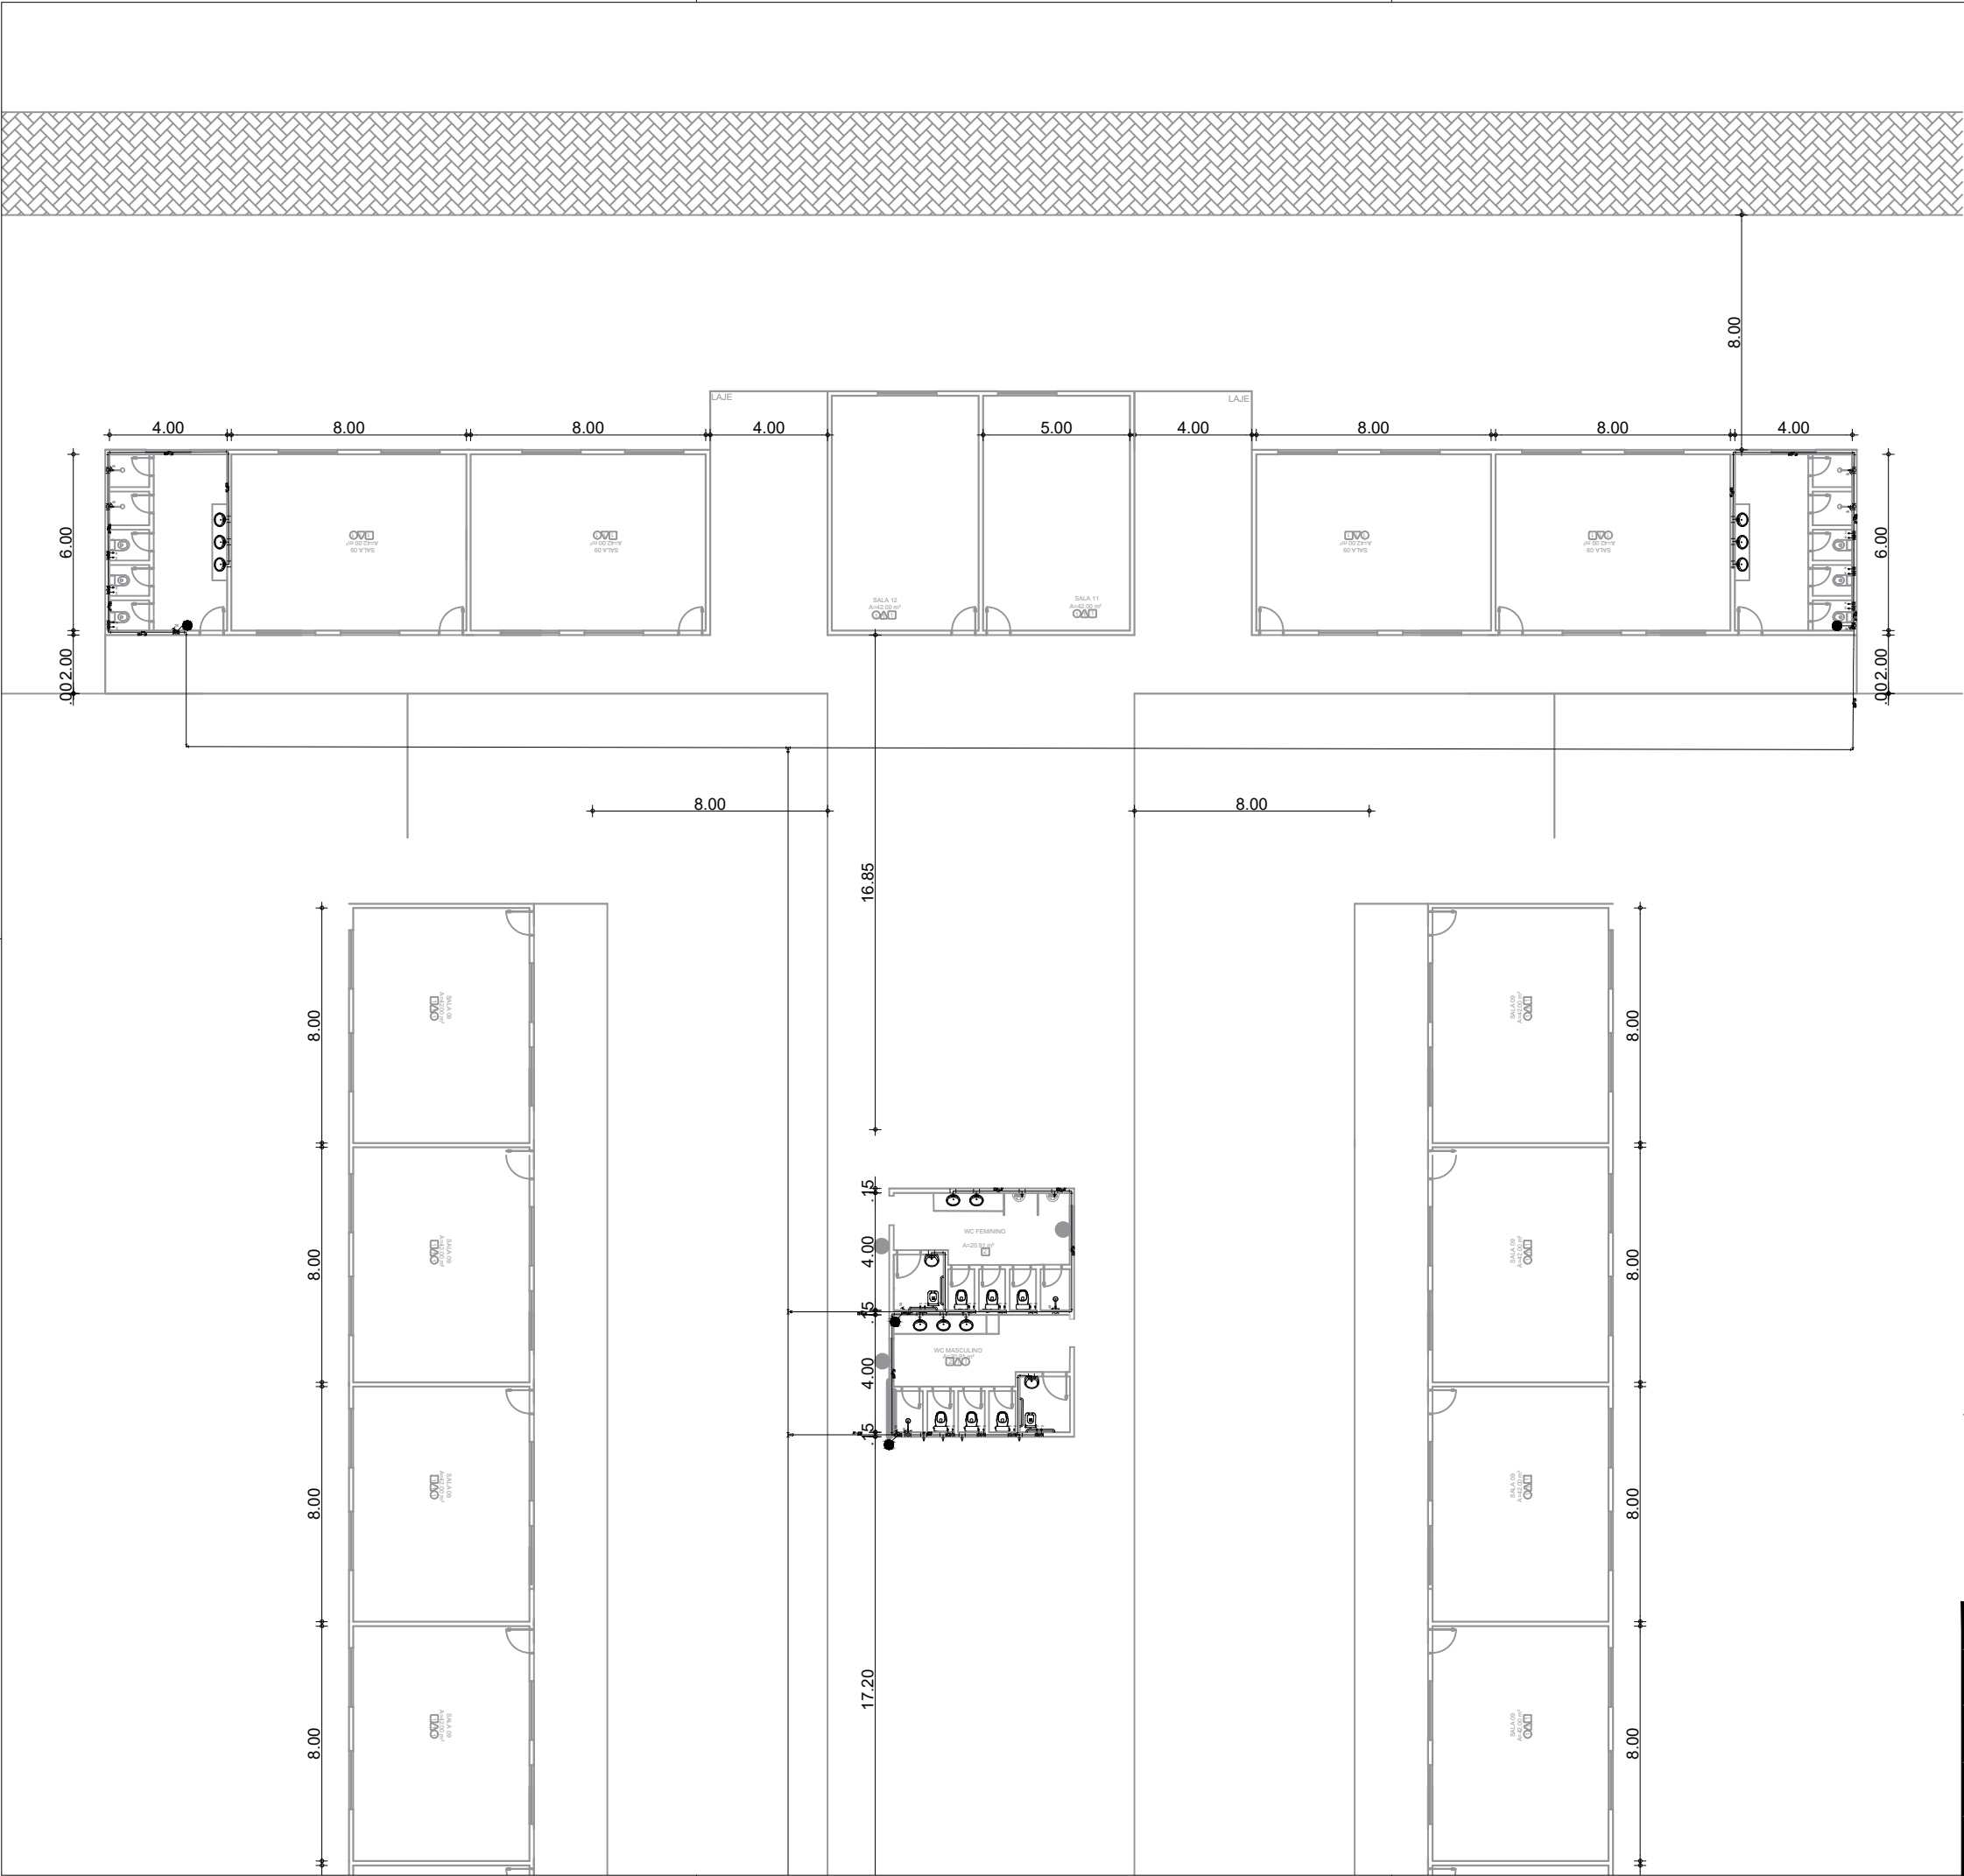

SIMBOLOGIA		
BLOCO	DESCRIÇÃO	DIÂMETRO (mm)
	JOELHO PVC RÍGIDO MARROM 90° 750kPa, SISTEMA SOLDÁVEL	25
		32
		40
		50
		60
		75
	TÊ PVC MARROM 750kPa, SISTEMA SOLDÁVEL	25
		32
		40
		50
		60
		75
	TÊ DE REDUÇÃO CENTRAL PVC MARROM 750kPa, SISTEMA SOLDÁVEL	40 x 32
		50 x 25
		50 x 32
		50 x 40
		60 x 25
		60 x 50
	BUCHA DE REDUÇÃO LONGA PVC MARROM 750kPa, SISTEMA SOLDÁVEL	75 x 50
		75 x 60
		40 x 25
		50 x 25
		50 x 32
		60 x 25
		60 x 32
		60 x 40
		60 x 50
		75 x 50
		40 x 25
		50 x 25
	TUBO QUE DESCE	25 A 75
	TUBO QUE SOBE	25 A 75
	TUBO QUE PASSA	25 A 75
	VÁLVULA ESFERA	20 A 75
	VÁLVULA GAVETA	20 A 75
	REGISTRO PRESSÃO	20 E 25
	HIDRÔMETRO	
	INDICAÇÃO DAS PRUMADAS	
	X: UTILIZAÇÃO	
	N: NÚMERO DA COLUNA	
	Ø: DIÂMETRO (mm)	

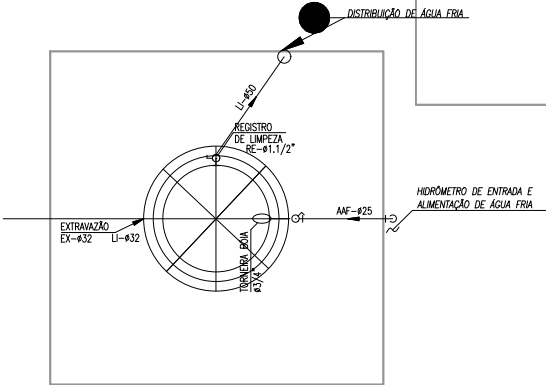

Cliente:	Identificação dos Desenhos:		
Prefeitura Municipal de Paracuru	01. DETALHE 3		
Obra:	Data:	Escala:	
FRANCISCO PAZ OLIVEIRA - VOLTA REDONDA	MAIO/2025	1/75	
Local:	07/14		
VOLTA REDONDA - PARACURU/CE			
Projeto:			
Arquitetônico			
Responsável:			